


METERS SHALL BE RECORDALL™ DISK METERS, PLASTIC LID AND RING, CUBIC FEET, STREET READ, METERS SHALL BE SUPPLIED WITH PREWIRED ORION™ PIT TRANSDUCER AND RTIR™. EQUIPMENT AVAILABLE FROM BADGER METER, INC. CHECK WITH CITY ENGINEER FOR ANY UPDATES TO THIS STANDARD. SEE W-33 FOR PIT MOUNTING DETAILS.

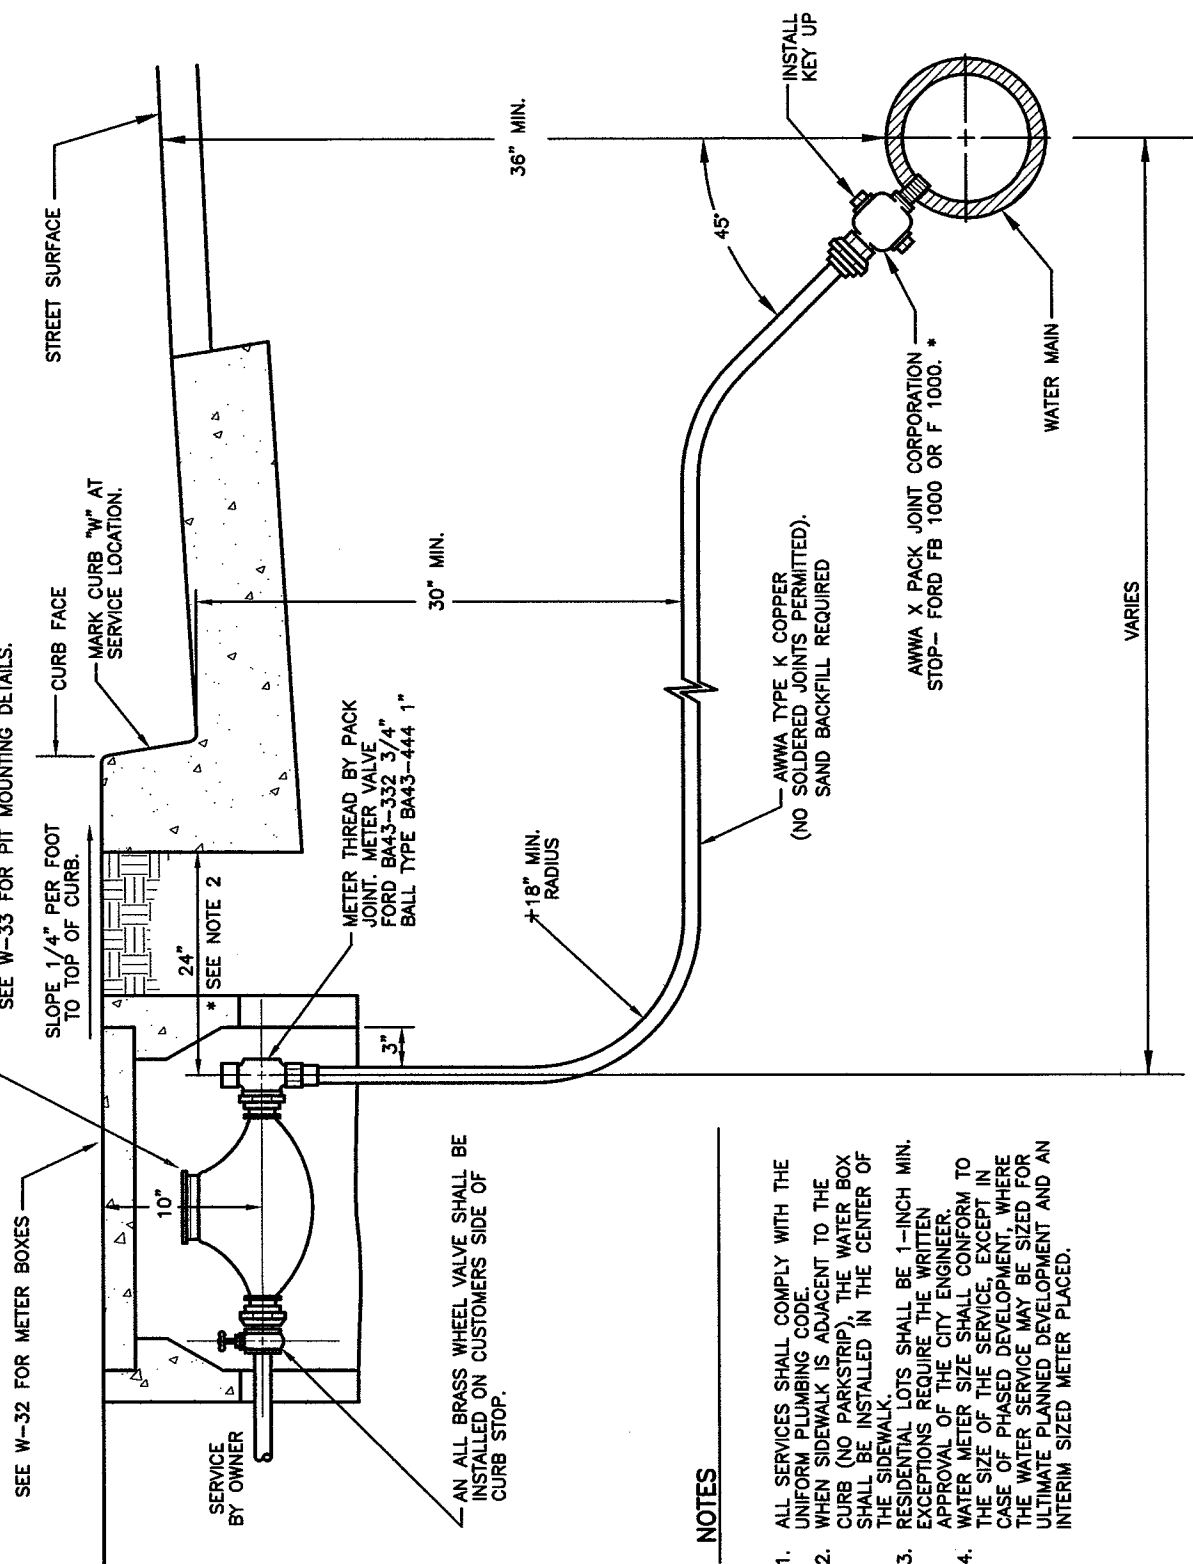

**NOTES**

1. ALL SERVICES SHALL COMPLY WITH THE UNIFORM PLUMBING CODE.
2. WHEN SIDEWALK IS ADJACENT TO THE CURB (NO PARKSTRIP), THE WATER BOX SHALL BE INSTALLED IN THE CENTER OF THE SIDEWALK.
3. RESIDENTIAL LOTS SHALL BE 1-INCH MIN. EXCEPTIONS REQUIRE THE WRITTEN APPROVAL OF THE CITY ENGINEER.
4. WATER METER SIZE SHALL CONFORM TO THE SIZE OF THE SERVICE, EXCEPT IN CASE OF PHASED DEVELOPMENT, WHERE THE WATER SERVICE MAY BE SIZED FOR ULTIMATE PLANNED DEVELOPMENT AND AN INTERIM SIZED METER PLACED.

\* COMPARABLE BY JAMES JONES AND MUELLER  
NOT TO SCALE

ENGINEERING DEPARTMENT		CITY OF MERCED, CA.	
<b>1" WATER SERVICE CONNECTION</b>			
DRAWN: KGE	APPROVED BY:	DATE	<b>W-3</b>
DATE: 2/02	<i>David L. Tucker</i>	<i>3/17/08</i>	
REVISED: 3/17/08	CITY ENGINEER		SHEET OF