


NOTES :

1. SECURE TRACER WIRE TO EACH FIRE HYDRANT AND EACH MAIN LINE VALVE COVER
2. TRACER WIRE SHALL BE LAID ON TOP OF THE WATER MAIN, AND SHALL BE TAPED TO THE PIPE AT EVERY 10' INTERVAL AND AT ALL CROSSES, TEES AND ELBOWS.
3. CONTRACTOR SHALL CONDUCT A CONTINUITY TEST ON ALL SOLDERED CONNECTIONS.
4. TRACER WIRE SPECIFICATION ARE SHOWN ON SHEET W-16A
5. DETAILS OF FIRE HYDRANT AND VALVE ASSEMBLY ARE SHOWN ON SHEET W-2
6. OVERALL CONTINUITY OF THE TRACER WIRE SYSTEM SHALL BE CHECKED TO THE SATISFACTION OF THE CITY AS A CONDITION OF ACCEPTANCE OF ANY NEWLY PLACED PVC WATER MAIN.

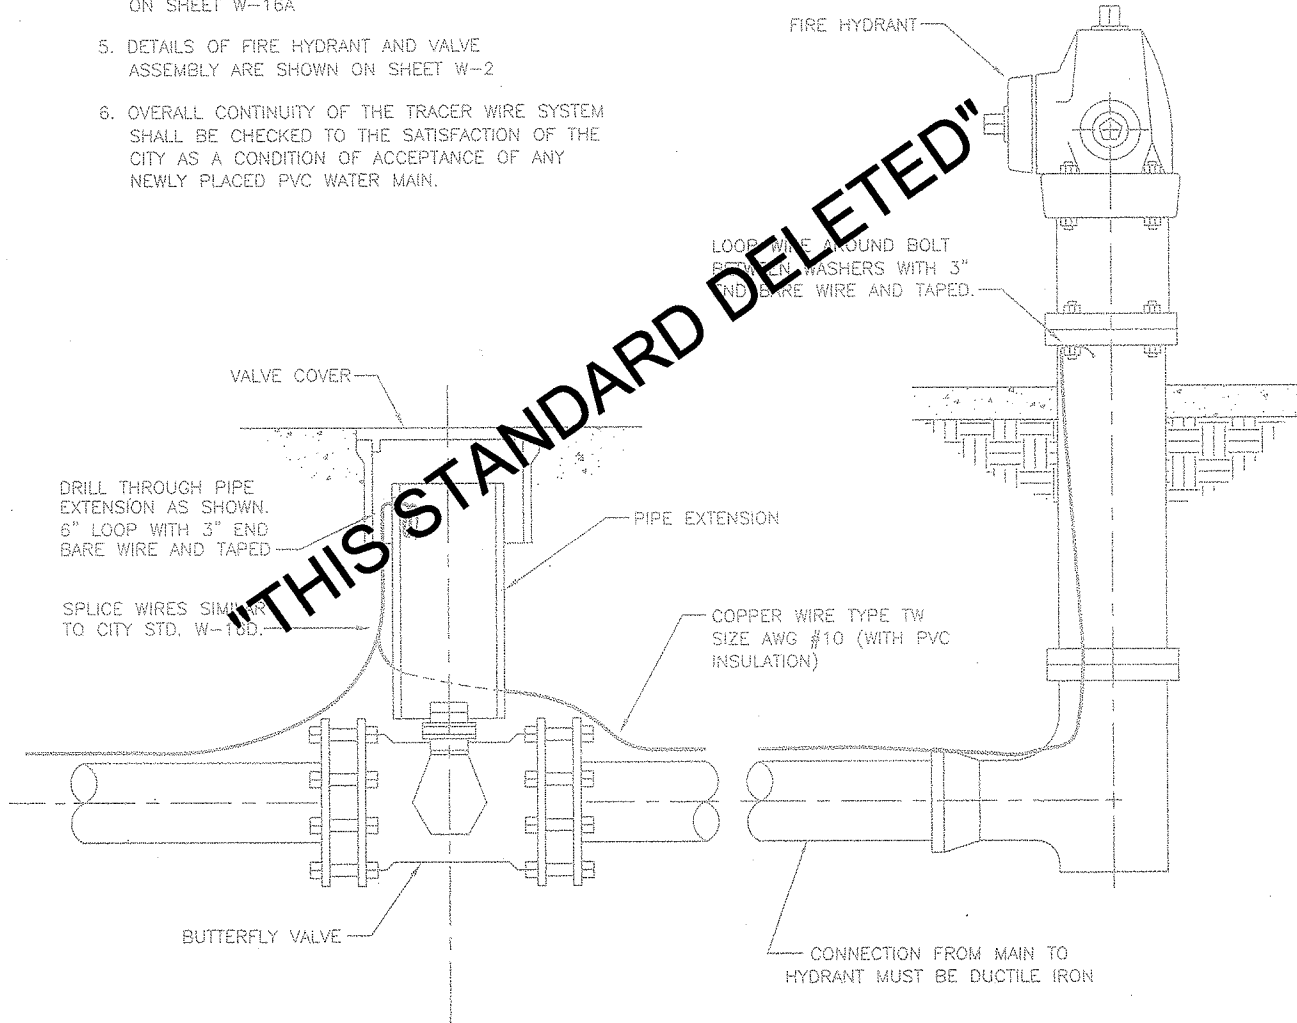

THIS STANDARD DELETED

ENGINEERING DEPARTMENT		CITY OF MERCED, CA.	
TRACER WIRE FOR PVC WATER MAIN			
DRAWN:	APPROVED BY:	DATE:	W-16B
DATE:	<i>David L. Tucke</i>	4/4/06	
REVISED: 4/02	CITY ENGINEER		SHEET OF